


Uppercut Elevators and lifts. Calgary 403.519.3186 Edmonton 587.597.9959

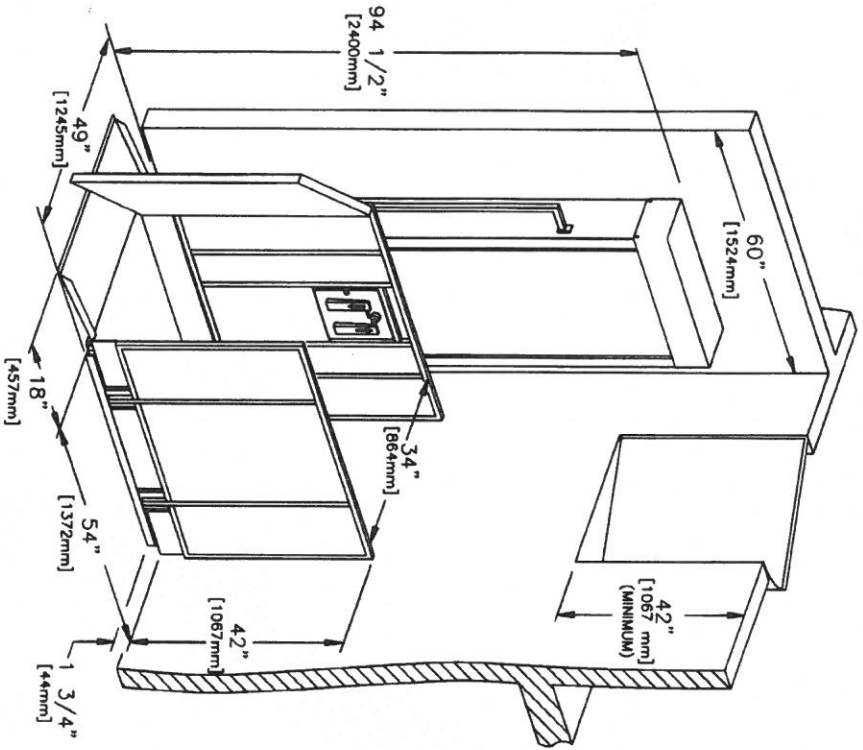

TRUS-T-LIFT DIMENSIONS

TOTAL TRAVEL	72 INCHES 1829 mm	INCHES	No. OF LANDINGS: 2	JOB No. -	SERIAL No. - S.O 38522
--------------	----------------------	--------	--------------------	-----------	---------------------------

LOCATION	-				
ARCHITECT	-				
GENERAL CONTRACTOR	-				

SPECIFICATIONS:

- 34" x 54" [864mm x 1372mm] LIFT PLATFORM
- 49" x 54" [1245mm x 1372mm] FOOTPRINT
- 94-1/2" [2400mm] TOWER HEIGHT
- 0" - 72" [0mm - 1829mm] LIFT RANGE
- MAXIMUM LOAD 750 lbs. [340 kg.]
- 8 F.P.M. [0.04 M/S] LIFT SPEED
- SCREW NUT SYNCHRONOUS BELT DRIVE
- MOTOR: 1/2 H.P. 110V A.C.
- POWER SUPPLY: 110V/1PH/60HZ C/W 15A FUSED DISCON.
- NON-LOAD BEARING BACKUP SAFETY NUT ON LIFT SHAFT
- ZERO-LOAD START IN BOTTOM POSITION

*DESIGNED & BUILT TO MEET CSA B355-00 SAFETY CODE
*DOORS: - UPPER STANDARD GATE, LOWER NONE, CARGATE

<input type="checkbox"/> Accepted as Shown
<input type="checkbox"/> Revise and Resubmit
<input type="checkbox"/> Accepted as Modified
Date: _____
Per: _____

*CLEARANCE DIMENSIONS AS PER CLIENT REQUEST AND MAY PRESENT INTERFERENCES DURING INSTALLATION


NOTES:
- Dimensions are in inches & [mm]



DWN. BY: GK	TRUS-T-LIFT ELEVATOR INSTALLATION DETAILS AND SPECIFICATIONS
CHECKED BY: RAM	

SCALE: N.T.S.	DATE: 10/06/2015	DRAWING No. 72CCLDUGNCST-750	1/2 REV A
---------------	------------------	------------------------------	-----------

Uppercut Elevators and lifts. Calgary 403.519.3186 Edmonton 587.597.9959

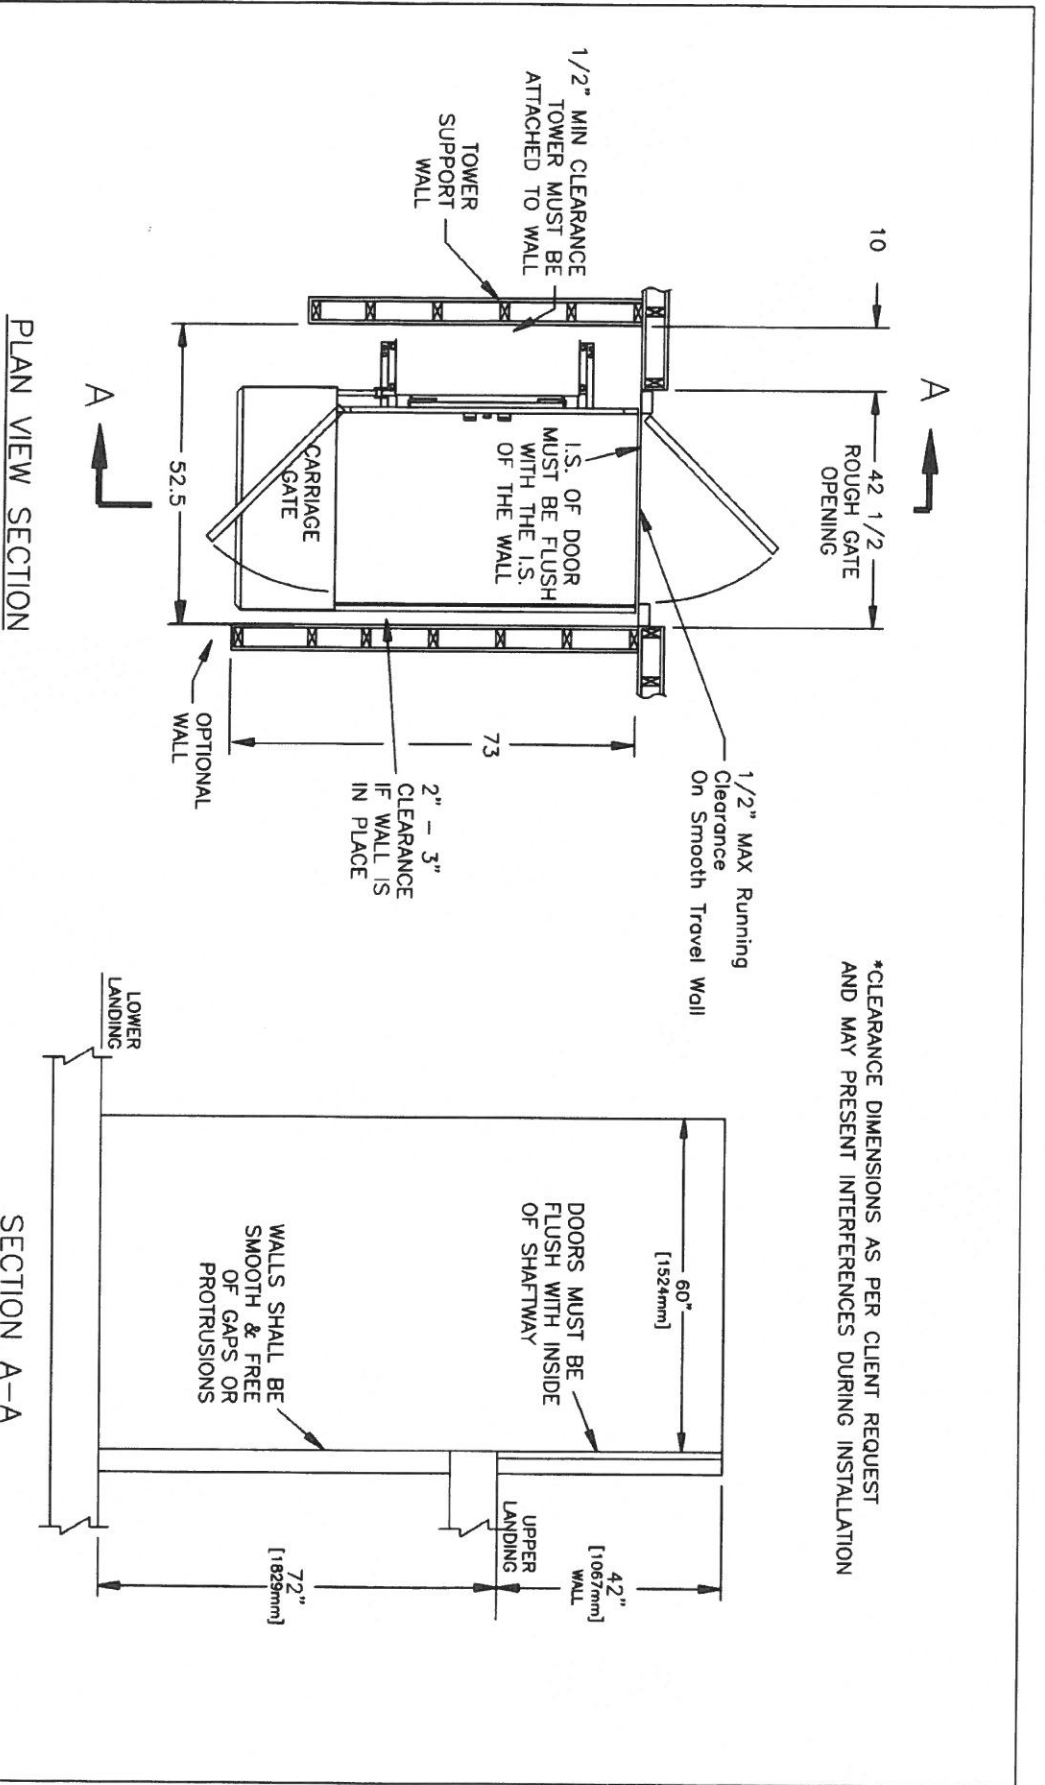

TOTAL TRAVEL	72 INCHES 1829 mm	NO. OF LANDINGS:	2	JOB No.:	-	SERIAL No.:	-	S.O	38522
LOCATION	-								
ARCHITECT	-								
GENERAL CONTRACTOR	-								
TRUS-LIFT									
DWN. BY: GK					TRUS-T-LIFT ELEVATOR INSTALLATION DETAILS AND SPECIFICATIONS				
CHECKED BY: XX									
SCALE: N.T.S.									
DATE: 10/06/2015					DRAWING No. 2/2 REV A 72CCLDUGNCST-750				

Uppercut Elevators and lifts. Calgary 403.519.3186 Edmonton 587.597.9959

COMMERCIAL TRUS<T>LIFT INSTALLATION SPECIFICATIONS

<p>CONTRACTOR RESPONSIBILITIES:</p> <p>SHAFT CONSTRUCTION</p> <ol style="list-style-type: none"> 1. Provide a support wall as per the attached drawings. 2. Provide rough opening for the doors and/or gates as shown on the attached drawings. 3. If metal studs are used to construct the support wall and shaft they must be reinforced with wood or steel backing plates where they attach to the tower and the door/gate frames. 			<p>CONTRACTOR RESPONSIBILITIES (Continued):</p> <p>ELECTRICAL</p> <ol style="list-style-type: none"> 1. Provide 110V power with a 15A fused & lockable disconnect to meet your local electrical code requirements. The disconnecting means must be located in an area that is visible from the lift area, and can be easily reached from the entrances. 			<p>LIFT CONTRACTORS RESPONSIBILITIES</p> <ol style="list-style-type: none"> 1. Provide construction drawings if required. 2. Install all lift components to meet the local code requirements. 3. Coordinate and attend Initial Inspection (if required). 4. Address all directives relating to the lift. 5. Provide operations manuals. 		
JOB No.	TOTAL TRAVEL	INCHES mm	No. OF LANDINGS	<p style="text-align: center;">TRUS T LIFT</p> <p style="text-align: center;">TRUS-T-LIFT COMMERCIAL UNENCLOSED INSTALLATION DETAILS</p>				
LOCATION			2					
ARCHITECT								
GENERAL CONTRACTOR		DWN. BY: BH		CHECKED BY:		SCALE: N.T.S.		
				DATE:		DRAWING No. UENCL-COMM-ITL-1-2/2		
						REV		